Mono County Community Development Department

P.O. Box 3569 Mammoth Lakes, CA 93546 (760) 924-1800, fax 924-1801

Building Division

www.monocounty.ca.gov

P.O. Box 8 Bridgeport, CA 93517 (760) 932-5432, fax 932-5431

Solar PV Standard Plan - Simplified Central/String Inverter System for One-and Two-Family Dwellings 4.1

SCOPE: Use this plan ONLY for utility-interactive central/string inverter systems not exceeding a system AC inverter output rating of 10kW on the roof of a one- or two-family dwelling or accessory structure. The photovoltaic system must interconnect to the load side of a single-phase AC service panel of nominal 120/240Vac with a bus bar rating of 225A or less. This plan is not intended for bipolar systems, hybrid systems or systems that utilize storage batteries, charge controllers, trackers, more than two inverters or more than one DC combiner (noninverter-integrated) per inverter. Systems must be in compliance with current California Building Standards Codes and local amendments of the authority having jurisdiction (AHJ). Other Articles of the California Electrical Code (CEC) shall apply as specified in 690.3.

MANUFACTURER'S SPECIFICATION SHEETS MUST BE PROVIDED for proposed inverter, modules, combiner/junction boxes and racking systems. Installation instructions for bonding and grounding equipment shall be provided, and local AHJs may require additional details. Listed and labeled equipment shall be installed and used in accordance with any instructions included in the listing or labeling (CEC 110.3). Equipment intended for use with PV system shall be identified and listed for the application (CEC 690.4[D]).

Job Address:	Permit #:
Contractor/Engineer Name:	License # and Class:
Signature: Date:	Phone Number:
Total # of Inverters installed:(If more than c Calculation Sheets" and the "Load Center Calculations"	· · · · · · · · · · · · · · · · · · ·
Inverter 1 AC Output Power Rating:	Watts
Inverter 2 AC Output Power Rating (if applicable): _	Watts
Combined Inverter Output Power Rating:	≤ 10,000 Watts
Ambient Temperature Adjustment Factors: select the build with the corresponding Ambient Temperature Corrections	•
1) ☐ If T _L is greater than or equal to -5°C, C _F = 1.12	
☐ If TL is between -6°C and -10°C, CF = 1.14	
Average ambient high temperature (T _H) = 47° C	
Note: For a lower T _L or a higher T _H , this plan is no	t applicable
DC Information:	
Module Manufacturer:	
2) Module V _{oc} (from module nameplate):Volts	3) Module I _{sc} (from module nameplate):Amps If I _{sc} > 13 Amps this plan not applicable
4) Module DC output power under standard test cond	itions (STC) = Watts (STC)

5) DC Module Layout															
Identify each source circuit (string) for inverter 1 shown on the roof plan with a Tag (e.g. A, B,C,)	Identify, by tag, which source circuits on the roof are to be paralleled (if none, put N/A)														
					Con	nbiner	1:								
		-													
		Con	nbiner	2:											
Total number of source circuits	for invert	er 1:													
6) Are DC/DC Converters	used?	□ Ye	es 🗆] No	If No	, skip	to S	Step	7. If \	⁄es er	nter in	nfo b	elow	<i>'</i> .	
DC/DC Converter Model #:			_		DC	C/DC Co	nver	ter M	ax DC	Input	Volta	ge:		_ Volt	S
Max DC Output Current:				ps		ax DC C									
Max # of DC/DC Converters in	an Input	Circuit:			DC	C/DC Co	nver	ter M	ax DC	Input	Powei	r:		Watts	
7) Maximum System DC V															
Only for systems w						- /C+-	- - - \			C- /C+	1\				
A. Module Voc (Step 2) x # of modules in series (Step 5) x Cr (Step 1) = V											V				
A. Wodule Voc (Step		Table 1. Maximum Number of PV Modules in Series Based on Module Rated V _{oc} for 600 Vdc Rated Equipment (CEC 690.7)												7)	
Table 1. Maximum Number	r of PV M	1odules	in Serie	es Based	on Mod	dule Rat	T					ipmer	nt (CEC		
Table 1. Maximum Number Max. Rated Module Voc (*1.:	r of PV M 2) 29.76	1odules	in Serie	es Based	on Mod	dule Rat	T		8.70	dc Rate 53.57	59.52	ipmer	nt (CEC		7) 89.29
Table 1. Maximum Number Max. Rated Module Voc (*1.:	r of PV M 2) 29.76 4) 29.24	31.51	in Serie	as Based 3 35.71	on Mod	dule Rat	44.	64 4				ipmer	nt (CEC	6.53	
Table 1. Maximum Numbo Max. Rated Module V_{oc} (*1 (Vol Max. Rated Module V_{oc} (*1	r of PV M 2) 29.76 4) 29.24	31.51	in Serie	as Based 3 35.71	38.27	dule Rat 41.21	44.	64 4 86 4	8.70	53.57	59.52	ipmer	nt (CEC 96 70 79 79	6.53	89.29
Table 1. Maximum Numbo Max. Rated Module V_{oc} (*1.: (Vol Max. Rated Module V_{oc} (*1.: (Vol	r of PV M 2) 29.76 4) 29.24 dc 18	31.51 30.96	33.48 32.89	3 35.71 3 35.09 15	38.27 37.59	41.21 40.49	43.	64 4 86 4 2	7.85 11	53.57 52.63 10	59.52 58.48 9	66.9 65.3	nt (CEC)	5.19	89.29 87.72
Table 1. Maximum Number Max. Rated Module Voc (*1.:	r of PV M 2) 29.76 4) 29.24 dc 18 alue calcu	31.51 30.96 17	in Serie 33.48 3 32.89 16	as Based 3 35.71 3 35.09 15 aust be les	38.27 37.59 14	41.21 40.49 13	44. 43.	64 4 86 4 2	8.70 7.85 11 max De	53.57 52.63 10	59.52 58.48 9	66.9 65.7 8	79 75 FP 6).	5.53 5.19 7	89.29 87.72
Table 1. Maximum Number Max. Rated Module Voc (*1 (Vol Max. Rated Module Voc (*1 (Vol Max # of Modules for 600 V Use for DC/DC converters. The v	r of PV M 2) 29.76 4) 29.24 dc 18 alue calcu	31.51 30.96 17	in Serie 33.48 3 32.89 16	as Based 3 35.71 3 35.09 15 aust be les	38.27 37.59 14	41.21 40.49 13	44. 43.	64 4 86 4 2	8.70 7.85 11 max De	53.57 52.63 10	59.52 58.48 9	66.9 65.7 8	79 75 FP 6).	5.53 5.19 7	89.29 87.72 6
Table 1. Maximum Number Max. Rated Module V_{oc} (*1 (Vol Max. Rated Module V_{oc} (*1 (Vol Max # of Modules for 600 V Use for DC/DC converters. The volume of the second	2) 29.76 4) 29.24 s) 29.24 c 18 alue calcu	31.51 30.96 17 ulated b	in Serie 33.48 5 32.89 16 pelow m	28 Based 3 35.71 3 35.09 15 15 per conv	38.27 37.59 14 ss than	41.21 40.49 13 DC/DC (44. 43. 1.	64 4 86 4 2 erter r	8.70 7.85 11 max Do	53.57 52.63 10 C input	59.52 58.48 9 voltag	66.9 65.3 8 8 8 9 (STE	79 75 FP 6).	5.19 7	89.29 87.72 6
Table 1. Maximum Number Max. Rated Module V_{oc} (*1 (Vol.) Max. Rated Module V_{oc} (*1 (Vol.) Max # of Modules for 600 V Use for DC/DC converters. The vol. B. Module V_{oc} (STEP 2) =	r of PV M 2) 29.76 s) 29.24 dc 18 alue calcu	31.51 30.96 17 17 18 30.96	in Serie 33.48 33.48 16 16 16 16 17 18 19 19 10 10 10 10 10 10 10 10	28 Based 3 35.71 3 35.09 15 15 per conv	38.27 37.59 14 ss than	41.21 40.49 13 DC/DC (TEP 6)	44. 43. 1.	64 4 86 4 2 erter r	8.70 7.85 11 max Do	53.57 52.63 10 C input	59.52 58.48 9 voltag	66.9 65.3 8 8 8 9 (STE	79 75 FP 6).	5.19 7	89.29 87.72 6
Table 1. Maximum Number Max. Rated Module V_{oc} (*1 (Vol.) Max. Rated Module V_{oc} (*1 (Vol.) Max # of Modules for 600 V Use for DC/DC converters. The vol. B. Module V_{oc} (STEP 2) = Table 2. Largest Module V_{oc} (*1 4 (*1 4 4 4 4 4 4 4	r of PV M 2) 29.76 4) 29.24 dc 18 alue calcus for Single 2) 30.4 4) 29.8	31.51 30.96 17 ulated b x # of m	in Series 33.48 33.48 16 16 16 17 18 19 19 19 19 19 19 19 19 19	as Based 3 35.71 9 35.09 15 uust be le: per conv	38.27 37.59 14 ss than erter (S	41.21 40.49 13 DC/DC (TEP 6) _	44. 43. 1. conve	64 4 86 4 2 erter r	8.70 7.85 11 max D0 x Cr (S	53.57 52.63 10 C input TEP 1)	59.52 58.48 9 voltag	66.9 65.3 8 8 8 8 C 690	79 75 EP 6).	5.53 5.19 7	89.29 87.72 6
Table 1. Maximum Number Max. Rated Module V_{oc} (*1 (Vol.) Max. Rated Module V_{oc} (*1 (Vol.) Max # of Modules for 600 V Use for DC/DC converters. The vol. B. Module V_{oc} (STEP 2) = Table 2. Largest Module V_{oc} (*1 (Vol.) Max. Rated Module V_{oc} (*1 (Vol.)	r of PV M 2) 29.76 4) 29.24 dc 18 alue calculation for Single 2) 30.4 4) 29.8 st 34	31.51 30.96 17 ulated b x # of m	in Series 33.48 33.48 34.89 16 16 16 16 17 18 19 19 19 10 10 10 10 10 10 10	25 Based 3 35.71 3 35.09 15 2 15 2 2 2 2 2 2 2 2 2 2 2 2 2 2 2 2 2 2 2	38.27 37.59 14 ss than erter (S	41.21 40.49 13 DC/DC (TEP 6)	44. 43. 1. conve	64 4 86 4 2 erter r (with 51.8	8.70 7.85 11 max D0 x Cr (S'	53.57 52.63 10 C input TEP 1) AFCI Ca 57.1	59.52 58.48 9 voltage = 59.8	8 65. 8 8 CC 6900 62.5	7. (CEC 7. 7. 7. 7. 7. 7. 7. 7. 7. 7. 7. 7. 7. 7	5.53 5.19 7 7 690.:	89.29 87.72 6 V
Table 1. Maximum Numbre Max. Rated Module V_{oc} (*1 (Vol. Max. Rated Module V_{oc} (*1 (Vol. Max # of Modules for 600 V.) Use for DC/DC converters. The v. B. Module V_{oc} (STEP 2) = Table 2. Largest Module V_{oc} (*1 (Vol. Max. Rated Module V_{oc} (*1 (Vol. DC/DC Converter Max DC Inp.	r of PV M 2) 29.76 4) 29.24 dc 18 alue calculation for Single 2) 30.4 4) 29.8 at 34	31.51 30.96 17 ulated b x # of m e-Modu 33.0 32.5	in Series 33.48 33.48 35.32.89 16 9elow modules 35.7 35.7 340 40 4	28 Based 3 35.71 3 35.09 15 20 C Converse 8.4 41.1 7.7 40.4 43 46	38.27 37.59 14 ss than erter (S	41.21 40.49 13 DC/DC (TEP 6) _	44. 43. 1. 1. 1. 1. 1. 1. 1. 1. 1. 1. 1. 1. 1.	64 4 4 4 4 4 8 6 4 2	88.70 77.85 11 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1	53.57 52.63 10 C input TEP 1) AFCI Ca 57.1 56.1 64	59.52 58.48 9 e voltage = 59.8 58.8 67	66.5 65. 88 88 65. 65. 66. 65. 66. 65. 66. 66. 66. 66.	79 75 FEP 6).	5.53 5.19 7 7 66.7 76	89.29 87.72 6 _V 11) 70.5 69.3

·	9) Sizing Source Circuit Conductors Source Circuit Conductor Size = Min. #10 AWG copper conductor, 90° C wet (USE-2, PV Wire, XHHW-2, THWN-2, RHW-2) For up to 8 conductors in roof-mounted conduit exposed to sunlight at least ½" from the roof covering (CEC 310) Note: For over 8 conductors in the conduit or mounting height of lower than ½" from the roof, this plan not applicable.												
	10) Are PV source circuits combined prior to the inverter? ☐ Yes ☐ No If No, use Single Line Diagram 1 and proceed to Step 13. If Yes, use Single Line Diagram 2 with Single Line Diagram 4 and proceed to Step 12. Is source circuit OCPD required? ☐ Yes ☐ No Source circuit OCPD size (if needed): 15 Amps												
	Sizing PV Output Circuit Conductors — If a com Output Circuit Conductor Size = Min. #6 AWG				be use	d (Step	11),						
	12) Inverter DC Disconnect Does the inverter have an integrated DC disconnect? Yes No If Yes, proceed to step 14. If No, the external DC disconnect to be installed is rated forAmps (DC) and Volts (DC)												
	Inverter Information Manufacturer: Max. Continuous AC Output Current Rating: Integrated DC Arc-Fault Circuit Protection? Grounded or Ungrounded System?	Am	ps No (If N	No is se	lected,	Compr		ve Stan	idard P	lan)			
AC In	formation:												
-	14) Sizing Inverter Output Circuit Conductors and OCPD Inverter Output OCPD rating =Amps (Table 3) Inverter Output Circuit Conductor Size =AWG (Table 3)												
	Table 3. Minimum Inverter Output OCPD and Circuit Conductor Size												
	Inverter Continuous Output Current Rating (Amps) (Step 14) 12 16 20 24 28 32 36 40 48												
	Minimum OCPD Size (Amps)	15	20	25	30	35	40	45	50	60			
	Minimum Conductor Size (AWG, 75° C, Copper)	14	12	10	10	8	8	6	6	6			

15) Point	of	Connection	to	Utility	/
----	---------	----	------------	----	---------	---

Only load side connections are permitted with this plan. Otherwise, use Comprehensive Standard Plan.

Is the PV OCPD positioned at the opposite end from input feeder location or main OCPD location?

Yes
No, circle the Max Combined PV System OCPD(s) at 120% value as determined from Step 15 (or Step S20), bus bar Rating, and Main OCPD as shown in Table 4.

If No, circle the Max Combined PV System OCPD(s) at 100% value as determined from Step 15 (or Step S20), bus bar Rating, and Main OCPD as shown in Table 4.

Per 705.12(D)(2): [Inverter output OCPD size [Step #15 or S20] + Main OCPD Size] ≤ [bus size x (100% or 120%)]

Table 4. Maximum Combined Supply OCPD	s Based	on Bus	Bar Rati	ing (Am _l	ps) per (CEC 705	.12(D)(2)	
Bus Bar Rating	100	125	125	200	200	200	225	225	225
Main OCPD	100	100	125	150	175	200	175	200	225
Max Combined PV System OCPD(s) at 120% of Bus Bar Rating	20	50	25	60*	60*	40	60*	60*	45
Max Combined PV System OCPD(s) at 100% Bus Bar Rating	0	25	0	50	25	0	50	25	0

^{*}This value has been lowered to 60 A from the calculated value to reflect 10 kW AC size maximum.

Reduction of the main breaker is not permitted with this plan. Otherwise, use Comprehensive Standard Plan.

16)	Grounding and Bondin	g of Modules and Racking	System	(select one)


- Racking System listed to UL 2703 using modules identified in the listing
- Other method subject to AHJ approval

The rapid shutdown initiation device shall be labeled according to CEC 690.56(C), and its location shall be shown on the site plan drawing. The rapid shutdown initiation device may be the inverter output or input circuits' disconnecting means, the service main disconnect, or a separate device as approved by the AHJ. The disconnecting means shall be identified for the purpose, suitable for their environment, and listed as a disconnecting means. A single rapid shutdown initiation device shall operate all disconnecting means necessary to control conductors in compliance with CEC 690.12. Note: Check with the AHJ regarding approval where field verification of reduction of voltage within the time required by CEC 690.12 is performed. Rapid shutdown shall be provided as required by CEC 690.12 with one of the following methods (Select one): The inverter(s) is within 10 feet of the array, and the location of the inverter is such that uncontrolled PV system conductors are no greater than 3 feet of length within the building. A remotely-controlled AC disconnecting means is required immediately adjacent to or as close as practicable to the inverters and located within 10 feet of the array. The inverter(s) is within 10 feet of the array, and the location of the inverter is such that uncontrolled PV system conductors are no greater than 3 feet of length within the building. Reduction of the voltage for the inverter output within the time required by CEC 690.12 shall be verified in the field, or the inverter output is listed to UL 1741 with rapid shutdown capability. Remotely-controlled DC disconnecting means are located within 10 feet of the PV array and DC input of the inverter(s), and the locations of the disconnecting means are such that uncontrolled PV system conductors are no greater than 3 feet of length within the building. Reduction of the voltage for the inverter output within the time required by CEC 690.12 shall be verified in the field, or the inverter output within the time required by CEC 690.12 shall be ver	
the site plan drawing. The rapid shutdown initiation device may be the inverter output or input circuits' disconnecting means, the service main disconnect, or a separate device as approved by the AHJ. The disconnecting means shall be identified for the purpose, suitable for their environment, and listed as a disconnecting means. A single rapid shutdown initiation device shall operate all disconnecting means necessary to control conductors in compliance with CEC 690.12. Note: Check with the AHJ regarding approval where field verification of reduction of voltage within the time required by CEC 690.12 is performed. Rapid shutdown shall be provided as required by CEC 690.12 with one of the following methods (Select one): The inverter(s) is within 10 feet of the array, and the location of the inverter is such that uncontrolled PV system conductors are no greater than 3 feet of length within the building. A remotely-controlled AC disconnecting means is required immediately adjacent to or as close as practicable to the inverters and located within 10 feet of the array. The inverter(s) is within 10 feet of the array, and the location of the inverter is such that uncontrolled PV system conductors are no greater than 3 feet of length within the building. Reduction of the voltage for the inverter output within the time required by CEC 690.12 shall be verified in the field, or the inverter output is listed to UL 1741 with rapid shutdown capability. Remotely-controlled DC disconnecting means are located within 10 feet of the PV array and DC input of the inverter(s), and the locations of the disconnecting means are such that uncontrolled PV system conductors are no greater than 3 feet of length within the building. Reduction of the voltage for the inverter output within the time required by CEC 690.12 shall be verified in the field, or the inverter output within the time required by CEC 690.12 shall be verified in the field, or the DC-DC converter output and the inverter output within the time required by CEC 690.12 shal	17) Rapid Shutdown
□ The inverter(s) is within 10 feet of the array, and the location of the inverter is such that uncontrolled PV system conductors are no greater than 3 feet of length within the building. A remotely-controlled AC disconnecting means is required immediately adjacent to or as close as practicable to the inverters and located within 10 feet of the array. □ The inverter(s) is within 10 feet of the array, and the location of the inverter is such that uncontrolled PV system conductors are no greater than 3 feet of length within the building. Reduction of the voltage for the inverter output within the time required by CEC 690.12 shall be verified in the field, or the inverter output is listed to UL 1741 with rapid shutdown capability. □ Remotely-controlled DC disconnecting means are located within 10 feet of the PV array and DC input of the inverter(s), and the locations of the disconnecting means are such that uncontrolled PV system conductors are no greater than 3 feet of length within the building. Reduction of the voltage for the inverter output within the time required by CEC 690.12 shall be verified in the field, or the inverter output is listed to UL 1741 with rapid shutdown capability. □ Remotely-controlled DC disconnecting means is located within 10 feet of the array at the DC input of inverter(s) connected to a module level DC-DC converter circuit where the DC-DC converter circuit meets the requirements for controlled conductors when disconnected from the inverter. Reduction of the voltage for the DC-DC converter output and the inverter output within the time required by CEC 690.12 shall be verified in the field, or the DC-DC converter output and the inverter output are listed to UL 1741 with rapid shutdown capability. □ A UL 1741-listed and identified inverter(s) with input and output rapid shutdown capability supplying module level DC-DC converter circuit where the DC-DC converter circuit meets the requirements for controlled conductors when disconnected from the inverter.	the site plan drawing. The rapid shutdown initiation device may be the inverter output or input circuits' disconnecting means, the service main disconnect, or a separate device as approved by the AHJ. The disconnecting means shall be identified for the purpose, suitable for their environment, and listed as a disconnecting means. A single rapid shutdown initiation device shall operate all disconnecting means necessary to control conductors in compliance with CEC 690.12. Note: Check with the AHJ regarding approval where field verification of reduction of voltage within the
conductors are no greater than 3 feet of length within the building. A remotely-controlled AC disconnecting means is required immediately adjacent to or as close as practicable to the inverters and located within 10 feet of the array. The inverter(s) is within 10 feet of the array, and the location of the inverter is such that uncontrolled PV system conductors are no greater than 3 feet of length within the building. Reduction of the voltage for the inverter output within the time required by CEC 690.12 shall be verified in the field, or the inverter output is listed to UL 1741 with rapid shutdown capability. Remotely-controlled DC disconnecting means are located within 10 feet of the PV array and DC input of the inverter(s), and the locations of the disconnecting means are such that uncontrolled PV system conductors are no greater than 3 feet of length within the building. Reduction of the voltage for the inverter output within the time required by CEC 690.12 shall be verified in the field, or the inverter output is listed to UL 1741 with rapid shutdown capability. Remotely-controlled DC disconnecting means is located within 10 feet of the array at the DC input of inverter(s) connected to a module level DC-DC converter circuit where the DC-DC converter circuit meets the requirements for controlled conductors when disconnected from the inverter. Reduction of the voltage for the DC-DC converter output and the inverter output within the time required by CEC 690.12 shall be verified in the field, or the DC-DC converter output and the inverter output are listed to UL 1741 with rapid shutdown capability. A UL 1741-listed and identified inverter(s) with input and output rapid shutdown capability supplying module level DC-DC converter circuit where the DC-DC converter circuit meets the requirements for controlled conductors when disconnected from the inverter.	Rapid shutdown shall be provided as required by CEC 690.12 with one of the following methods (Select one):
conductors are no greater than 3 feet of length within the building. Reduction of the voltage for the inverter output within the time required by CEC 690.12 shall be verified in the field, or the inverter output is listed to UL 1741 with rapid shutdown capability. Remotely-controlled DC disconnecting means are located within 10 feet of the PV array and DC input of the inverter(s), and the locations of the disconnecting means are such that uncontrolled PV system conductors are no greater than 3 feet of length within the building. Reduction of the voltage for the inverter output within the time required by CEC 690.12 shall be verified in the field, or the inverter output is listed to UL 1741 with rapid shutdown capability. Remotely-controlled DC disconnecting means is located within 10 feet of the array at the DC input of inverter(s) connected to a module level DC-DC converter circuit where the DC-DC converter circuit meets the requirements for controlled conductors when disconnected from the inverter. Reduction of the voltage for the DC-DC converter output and the inverter output within the time required by CEC 690.12 shall be verified in the field, or the DC-DC converter output and the inverter output are listed to UL 1741 with rapid shutdown capability. A UL 1741-listed and identified inverter(s) with input and output rapid shutdown capability supplying module level DC-DC converter circuit where the DC-DC converter circuit meets the requirements for controlled conductors when disconnected from the inverter.	conductors are no greater than 3 feet of length within the building. A remotely-controlled AC disconnecting means is
inverter(s), and the locations of the disconnecting means are such that uncontrolled PV system conductors are no greater than 3 feet of length within the building. Reduction of the voltage for the inverter output within the time required by CEC 690.12 shall be verified in the field, or the inverter output is listed to UL 1741 with rapid shutdown capability. Remotely-controlled DC disconnecting means is located within 10 feet of the array at the DC input of inverter(s) connected to a module level DC-DC converter circuit where the DC-DC converter circuit meets the requirements for controlled conductors when disconnected from the inverter. Reduction of the voltage for the DC-DC converter output and the inverter output within the time required by CEC 690.12 shall be verified in the field, or the DC-DC converter output and the inverter output are listed to UL 1741 with rapid shutdown capability. A UL 1741-listed and identified inverter(s) with input and output rapid shutdown capability supplying module level DC-DC converter circuit where the DC-DC converter circuit meets the requirements for controlled conductors when disconnected from the inverter.	conductors are no greater than 3 feet of length within the building. Reduction of the voltage for the inverter output within the time required by CEC 690.12 shall be verified in the field, or the inverter output is listed to UL 1741 with
connected to a module level DC-DC converter circuit where the DC-DC converter circuit meets the requirements for controlled conductors when disconnected from the inverter. Reduction of the voltage for the DC-DC converter output and the inverter output within the time required by CEC 690.12 shall be verified in the field, or the DC-DC converter output and the inverter output are listed to UL 1741 with rapid shutdown capability. A UL 1741-listed and identified inverter(s) with input and output rapid shutdown capability supplying module level DC-DC converter circuit where the DC-DC converter circuit meets the requirements for controlled conductors when disconnected from the inverter.	inverter(s), and the locations of the disconnecting means are such that uncontrolled PV system conductors are no greater than 3 feet of length within the building. Reduction of the voltage for the inverter output within the time required by CEC 690.12 shall be verified in the field, or the inverter output is listed to UL 1741 with rapid shutdown
DC-DC converter circuit where the DC-DC converter circuit meets the requirements for controlled conductors when disconnected from the inverter.	connected to a module level DC-DC converter circuit where the DC-DC converter circuit meets the requirements for controlled conductors when disconnected from the inverter. Reduction of the voltage for the DC-DC converter output and the inverter output within the time required by CEC 690.12 shall be verified in the field, or the DC-DC converter
☐ A UL 1741-listed rapid shutdown system:	DC-DC converter circuit where the DC-DC converter circuit meets the requirements for controlled conductors when
· · · · · · · · · · · · · · · · · · ·	☐ A UL 1741-listed rapid shutdown system:
Manufacturer:	Manufacturer:
Testing Agency Name:	Testing Agency Name:
System Model Number:	
System Components:	

Solar PV Standard Plan — Simplified Central/String Inverter Systems for One- and Two-Family Dwellings

Markings


CEC Articles 690 and 705 and CA Residential Code Section R324 require the following labels or markings be installed at these components of the photovoltaic system:

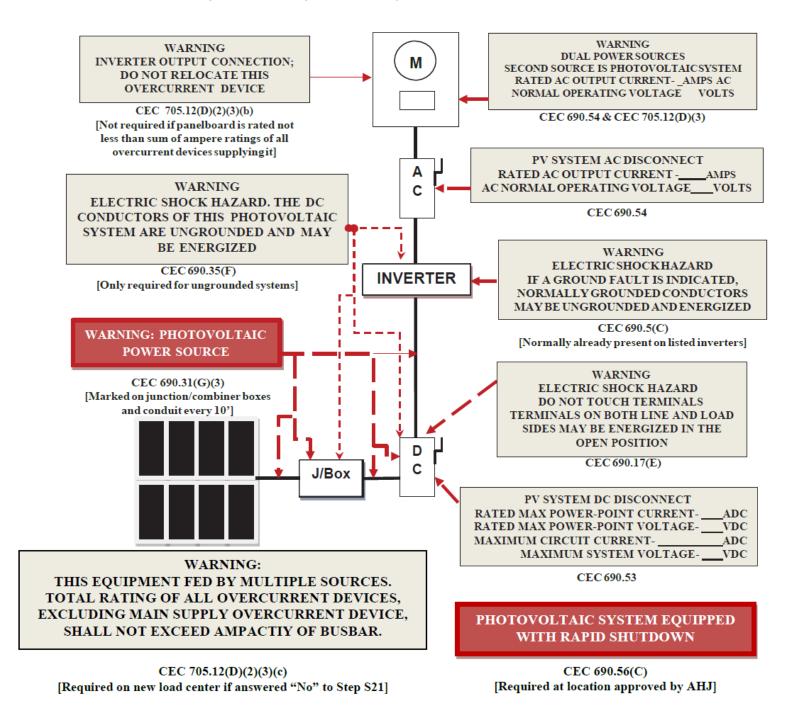


Informational note: ANSI Z535.4 provides guidelines for the design of safety signs and labels for application to products. A phenolic plaque with contrasting colors between the text and background would meet the intent of the code for permanency. No type size is specified, but 20 point (3/8") should be considered the minimum.

CEC 705.12 requires a permanent plaque or directory denoting all electric power sources on or in the premises or rapid fire shutdown equipment.

Solar PV Standard Plan – Simplified Central/String Inverter System for One- and Two-Family Dwellings

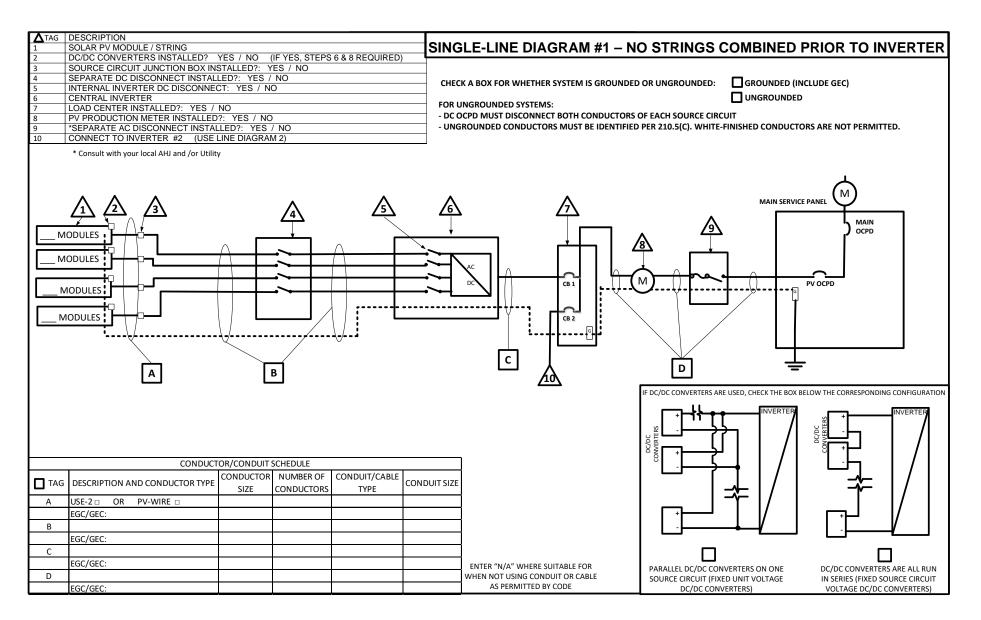

Solar PV Standard Plan – Simplified Central/String Inverter System for One- and Two-Family Dwellings

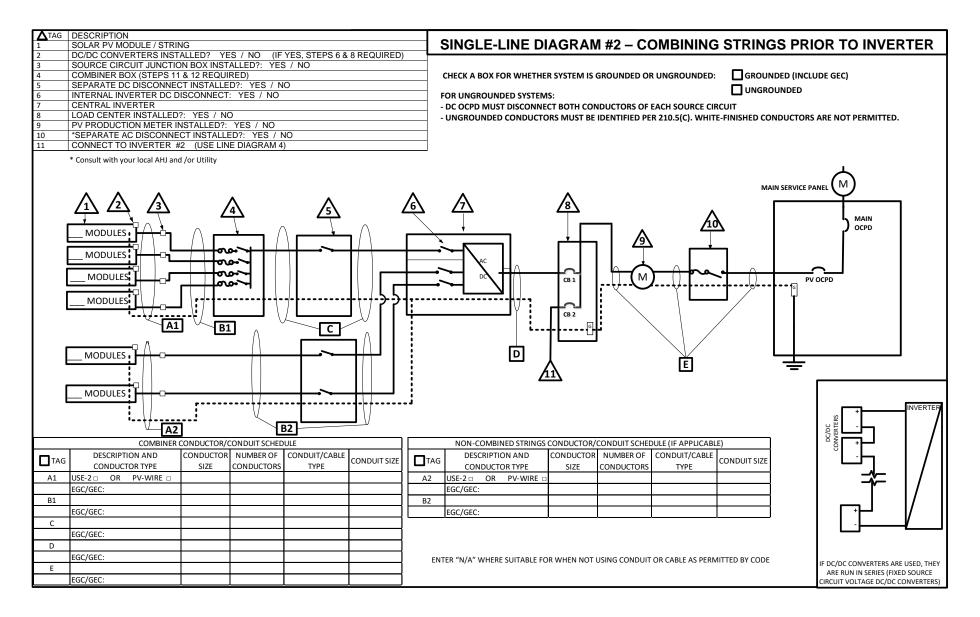

Supplemental Calculation Sheets for Inverter #2 (Only include if <u>second</u> inverter is used)

DC Information:

Module Manufacturer:		Model:										
S2) Module V _{oc} (from modu	le nameplate):Volts	S3) Module I _{sc} (from module nameplate):Amps										
S4) Module DC output power under standard test conditions (STC) = Watts (STC)												
S5) DC Module Layout												
Identify each source circuit (string) for inverter 1 shown on the roof plan with a Tag (e.g. A,B,C,) Number of modules per (e.g. A,B,C,) Identify, by tag, which source circuits on the roof are to be paralleled (if none, put N/A)												
		Combiner 1:										
		Combiner 2:										
Total number of source circuits	for inverter 1:											
S6) Are DC/DC Converte	rs used? □ Yes □ No	If No, skip to Step S7. If Yes, enter info below.										
DC/DC Converter Model #:		DC/DC Converter Max DC Input Voltage: Volts										
Max DC Output Current:	Amps	Max DC Output Current:Volts										
Max # of DC/DC Converters in	an Input Circuit:	DC/DC Converter Max DC Input Power: Watts										

S7) Maximum System DC Voltage — Use A1 or A2 for systems without DC/DC converters, and B1 or B2 with DC/DC Converters.															
A1. Module V_{OC} (STEP S2) =x # in series (STEP S5)x 1.12 (If -1 \leq T _L \leq -5°C, STEP S1) =V															
A2. Module V_{OC} (STEP S2) = x # in series (STEP S5) x 1.14 (If $-6 \le T_L \le -10^{\circ}$ C, STEP S1) = V												V			
Table 1. Maximum Number of PV Modules in Series Based on Module Rated V _{oc} for 600 Vdc Rated Equipment (CEC 690.7)															
Max. Rated Module V _{oc} (*1.12) (Volts) 29.76 31.51 33.48 35.71 38.27 41.21 44.64 48.70 53.57 59.52 66.96 76.53 89.29														89.29	
Max. Rated Module V _{oc} (*1.14) (Volts) 29.24 30.96 32.89 35.09 37.59 40.49 43.86 47.85 52.63 58.48 65.79 75.19 87.72															
Max # of Modules for 600 Vdc	18	17	16	15	14	13	12	2	11	10	9	8		7	6
Use for DC/DC converters. The value	ie calcul	ated be	low mu	st be le	ss than	DC/DC	conve	erter	max D	C input	voltag	e (STE	P S6).		
B1. Module V _{oc} (STEP S2) =	x	# of mo	dules p	er conv	erter (S	TEP S6	5)	x	1.12 (lf -1 ≤ 7	「 _ເ ≤ -5°	C, STE	P S1) =	=	V
B2. Module V _{oc} (STEP S2) =	x	# of mo	odules p	er conv	erter (S	STEP S6	5)	x	1.14 (1	f -6 ≤ T	_ ≤ -10	°C, ST	EP S1)	=	V
Table 2. Largest Module V _{oc} fo	r Single	-Module	e DC/D(C Conve	rter Co	nfigura	ations	(with	80 V A	AFCI Ca	ap) (CE	C 690	.7 and	l 690.1	11)
Max. Rated Module V _{oc} (*1.12) (Volts)	30.4	33.0 3	5.7 38.	4 41.1	43.8	46.4	49.1	51.8	54.5	57.1	59.8	62.5	65.2	67.9	70.5
Max. Rated Module V _{oc} (*1.14) (Volts)	29.8	32.5 3	5.1 37.	7 40.4	43.0	45.6	48.2	50.9	53.5	56.1	58.8	61.4	64.0	66.7	69.3
DC/DC Converter Max DC Input (Step 6) (Volts)	34	37 4	10 43	46	49	52	55	58	61	64	67	70	73	76	79
S8) Maximum System DC V Maximum System DC V	_						nvert	er –	- Onl	y req	uired	if Ye	s in S	Step :	S6
S9) Maximum Source Circu Is Module I _{sc} below 9.6			S3)?	□ Ye	es c	No No	(If No	o, us	e Coi	mpre	hensi	ve St	anda	ard P	lan)
Source Circuit Conductor THWN-2, RHW-2) For up to 8 conductors in r	S10) Sizing Source Circuit Conductors Source Circuit Conductor Size = Min. #10 AWG copper conductor, 90° C wet (USE-2, PV Wire, XHHW-2, THWN-2, RHW-2) For up to 8 conductors in roof-mounted conduit exposed to sunlight at least ½" from the roof covering (CEC 310) Note: For over 8 conductors in the conduit or mounting height of lower than ½" from the roof, use Comprehensive														
S11) Are PV source circuits combined prior to the inverter?															
S12) Sizing PV Output Circuit Conductors — If a combiner box will NOT be used (Step S11), Output Circuit Conductor Size = Min. #6 AWG copper conductor															
S13) Inverter DC Disconnect Does the inverter have an If No, the external DC d															(DC)

S14) Inverter Information Manufacturer: Max. Continuous AC Output Current Rating:	An		odel: _							
	Integrated DC Arc-Fault Circuit Protection? ☐ Yes ☐ No (If No is selected, Comprehensive Standard Plan) Grounded or Ungrounded System? ☐ Grounded ☐ Ungrounded										
AC In	formation:										
S15	S15) Sizing Inverter Output Circuit Conductors and OCPD Inverter Output OCPD rating =Amps (Table 3) Inverter Output Circuit Conductor Size = AWG (Table 3)										
	Table 3. Minimum Inverter 0	Output (OCPD ar	nd Circu	it Condເ	ıctor Siz	е				
	Inverter Continuous Output Current Rating (Amps) (Step 14)	12	16	20	24	28	32	36	40	48	
	Minimum OCPD Size (Amps)	15	20	25	30	35	40	45	50	60	
	Minimum Conductor Size (AWG, 75° C, Copper)	14	12	10	10	8	8	6	6	6	


Load Center Calculations (Omit if a load center will not be installed for PV OCPDs)

S20) Load Center Output:
Calculate the sum of the maximum AC outputs from each inverter.
Inverter #1 Max Continuous AC Output Current Rating [STEP S14] × 1.25 = Amps
Inverter #2 Max Continuous AC Output Current Rating [STEP S14] × 1.25 = Amps
Total inverter currents connected to load center (sum of above) = Amps
Conductor Size: AWG
Overcurrent Protection Device:Amps
Load center bus bar rating:Amps
The sum of the ampere ratings of overcurrent devices in circuits supplying power to a bus bar or conductor shall not exceed 120 percent of the rating of the bus bar or conductor.

Solar PV Standard Plan – Simplified Central/String Inverter System for One- and Two-Family Dwellings

1	DESCRIPTION SOLAR PV MODULE / STRING				SI	NGLE-LINE DIAGRAM #3 –	ADDITIONAL	INVERTER	FOR DIAGRAM #1
3 4	DC/DC CONVERTERS INSTALLED? SOURCE CIRCUIT JUNCTION BOX INS SEPARATE DC DISCONNECT INSTALI INTERNAL INVERTER DC DISCONNEC	STALLED?: YES LED?: YES / N	S / NO NO	6 & 8 REQUIRED)	IN\	/ERTER # 2			
5 6 7 8	"SEPARATE AC DISCONNECT CENTRAL INVERTER "SEPARATE AC DISCONNECT INSTAL TO LOAD CENTER ON LINE DIAGRAM * Consult with your local AHJ and /or Utility	LED?: YES / N			FOR U	CK A BOX FOR WHETHER SYSTEM IS GROUNDED UNGROUNDED SYSTEMS: DOPD MUST DISCONNECT BOTH CONDUCTORS OF THE PROPERTY OF THE PROP	OF EACH SOURCE CIRCI		
	MODULES MODULES MODULES MODULES A		A B		5	C A	IF DC/DC CONVERTERS ARE	USED, CHECK THE BOX BE	LOW THE CORRESPONDING CONFIGURATION INVERTER OO
	COMPUST	COR/CONDUIT CO	CUEDINE			1		 	└ ╵ ┐
	DESCRIPTION AND CONDUCTOR TYPE			CONDUIT/CABLE TYPE	CONDUIT SIZE			╬	
A	USE-2 □ OR PV-WIRE □ EGC/GEC:					}		 /	
В]			
С	EGC/GEC:					ENTER "N/A" WHERE SUITABLE FOR WHEN	PARALLEL DC/DC CON		DC/DC CONVERTERS ARE ALL RUN
	EGC/GEC:					NOT USING CONDUIT OR CABLE AS PERMITTED BY CODE	SOURCE CIRCUIT (FIXE DC/DC CONV		IN SERIES (FIXED SOURCE CIRCUIT VOLTAGE DC/DC CONVERTERS)

Solar PV Standard Plan – Simplified Central/String Inverter System for One- and Two-Family Dwellings

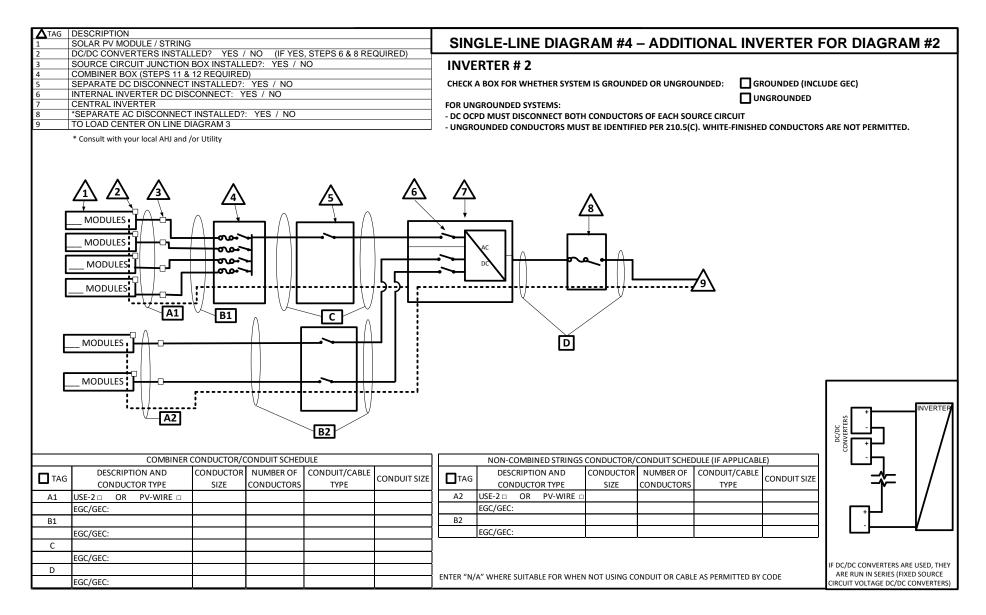

SOLAR PV STANDARD PLAN Roof Layout Diagram for One- and Two-Family Dwellings	

Items required: roof layout of all panels, modules, clear access pathways and approximate locations of electrical disconnecting means and roof access points.